



**NOTE:**  
 Shall only be utilized in conjunction with a flow equalization device to ensure that the interior void storage volume is not exceeded during peak flow events.

**Finished Grade shall be pitched to sheet flow**



**Cover material depth shall be  $\geq 6"$  and shall be uniform over system**

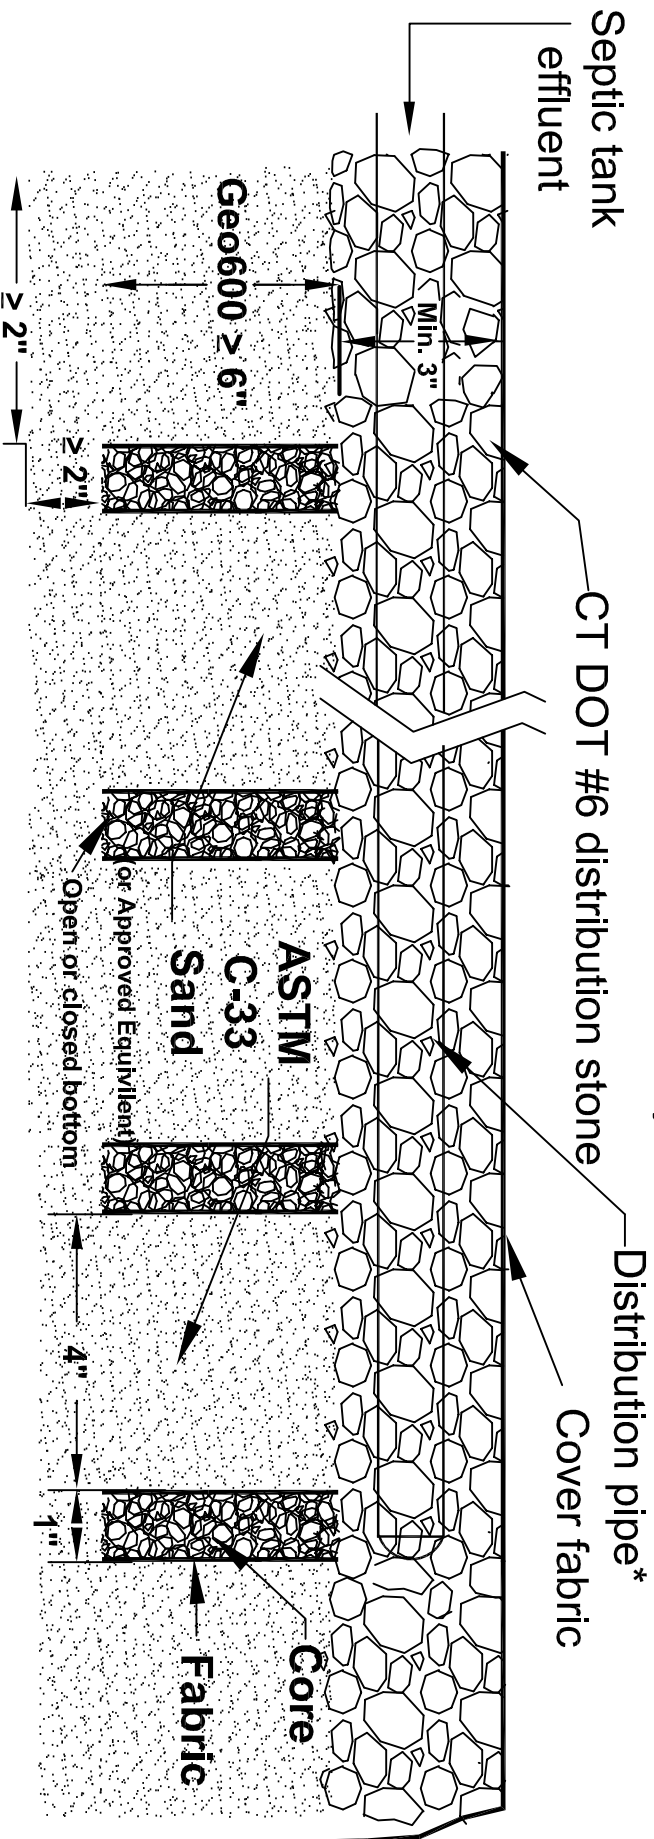

**\*3" min. I.D., ASTM D-3034, SDR 35 pipe for gravity applications**  
**0.75" min. I.D., ASTM D-2665, SCH 40 PVC pipe for pressure applications**

**GEOMAT EDGE™ ST 600 LEACHING SYSTEM**  
**A-A' Cross Section**

Copyright 2007 GEOMATRIX, LLC  
 Patents Pending

GEOMAT EDGE 600 ST LEACHING SYSTEM	
A-A' Cross Section	
Geomatrix Systems, LLC.	
860-663-3993	
SCALE	NONE
DATE	6/28/07
DRAWN BY:	ERP
REV.	A062807
ACAD NO.	600 ST A-A.DWG
SHEET	2 OF 4