


FINISHED GRADE SHALL BE PITCHED TO SHEET  
 FLOW STORMWATER AWAY FROM SYSTEM  
 COVER MATERIAL DEPTH SHALL BE  $\geq 6"$   
 AND SHALL BE UNIFORM OVER SYSTEM  
 10 MIL POLY (IF SPECIFIED)  
 EXTEND TO EDGE OF  
 EXCAVATION (MINIMUM)

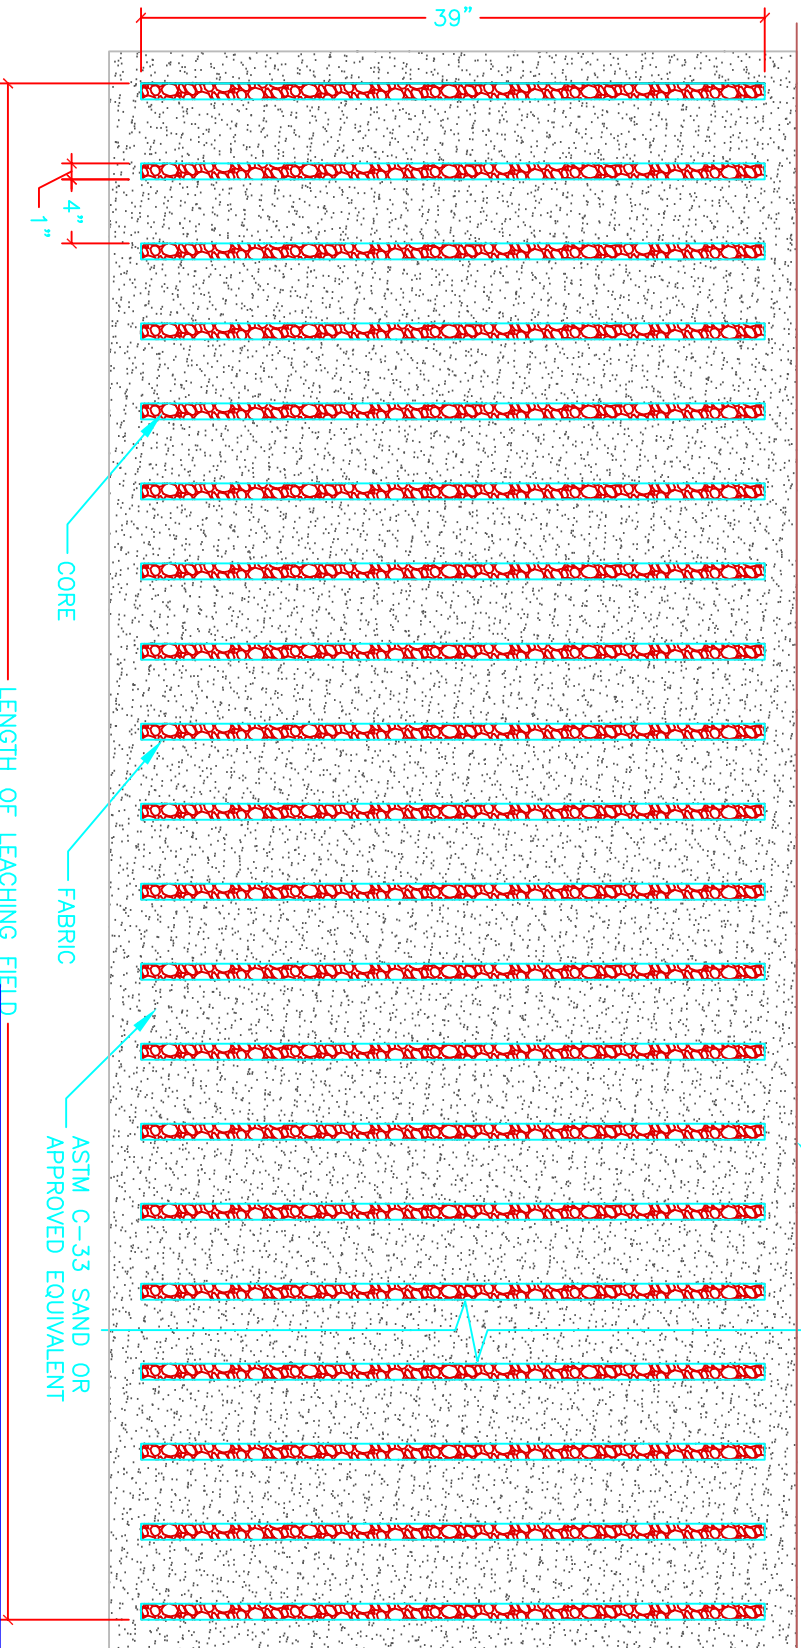

2" MINIMUM ASTM C-33 SAND  
 OR APPROVED EQUIVALENT ON  
 PERIMETER, BOTTOM AND TOP  
 OF SYSTEM

**GeoU3921 LEACHING TRENCH**

**CROSS SECTION A-A'**

SCALE: 1"=1'

**GeoMat Edge U-Shape  
 Leaching System**

Geomatrix Systems, LLC  
 114 Mill Rock Road East  
 Old Saybrook, CT 06475  
 (860) 510-0730

SCALE: 1"=1'  
 0 .5 1 2 FEET

DATE:	3/23/2011	REVISIONS:	
DRAWN BY:	SMM	ACAD NO.:	GEU 3921 A-A' VIEW.DWG
APPROVED BY:		SHEET NO.:	1 OF 1

Manufactured under one or more of the following U.S. Patents: 6,485,647, 6,762,401, 6,814,866, 6,887,383, 6,923,905, 6,959,882, 6,969,464, 7,157,001, 7,309,434, 7,351,005, 7,374,670, 7,465,390, 7,744,759