


FINISHED GRADE SHALL BE PITCHED TO SHEET  
FLOW STORWATER AWAY FROM SYSTEM

COVER MATERIAL DEPTH SHALL BE  $\geq 6"$   
AND SHALL BE UNIFORM OVER SYSTEM

10 MIL POLY (IF SPECIFIED)  
EXTEND TO EDGE OF  
EXCAVATION (MINIMUM)

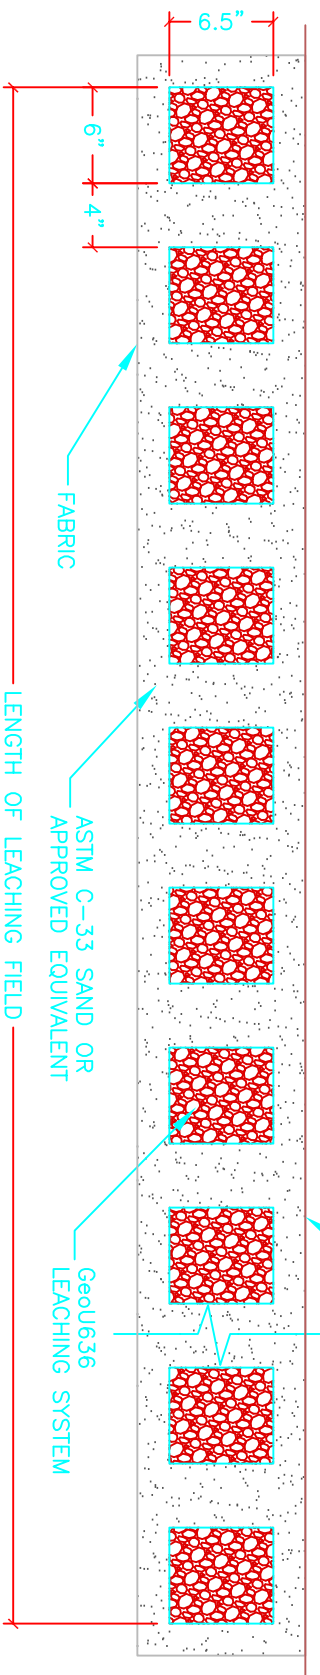

2" MINIMUM ASTM C-33 SAND  
OR APPROVED EQUIVALENT ON  
PERIMETER, BOTTOM AND TOP  
OF SYSTEM

## GeoU636 LEACHING TRENCH

### CROSS SECTION B-B'

SCALE: 1"=1'

## GeoMat Edge U-Shape Leaching System

Geomatrix Systems, LLC  
114 Mill Rock Road East  
Old Saybrook, CT 06475  
(860) 510-0730

SCALE: 1"=1'

0 .5 1 2 FEET

DATE: 4/7/2011

REVISIONS:

DRAWN BY: SMM

ACAD NO. GE0U 636 B-B' VIEW.DWG

APPROVED BY:

SHEET NO. 1 OF 1

Manufactured under one or more of the following U.S. Patents: 6,485,647, 6,762,401, 6,814,866, 6,887,383,  
6,923,905, 6,959,882, 6,969,464, 7,157,001, 7,309,434, 7,351,005, 7,374,670, 7,465,390, 7,744,759